

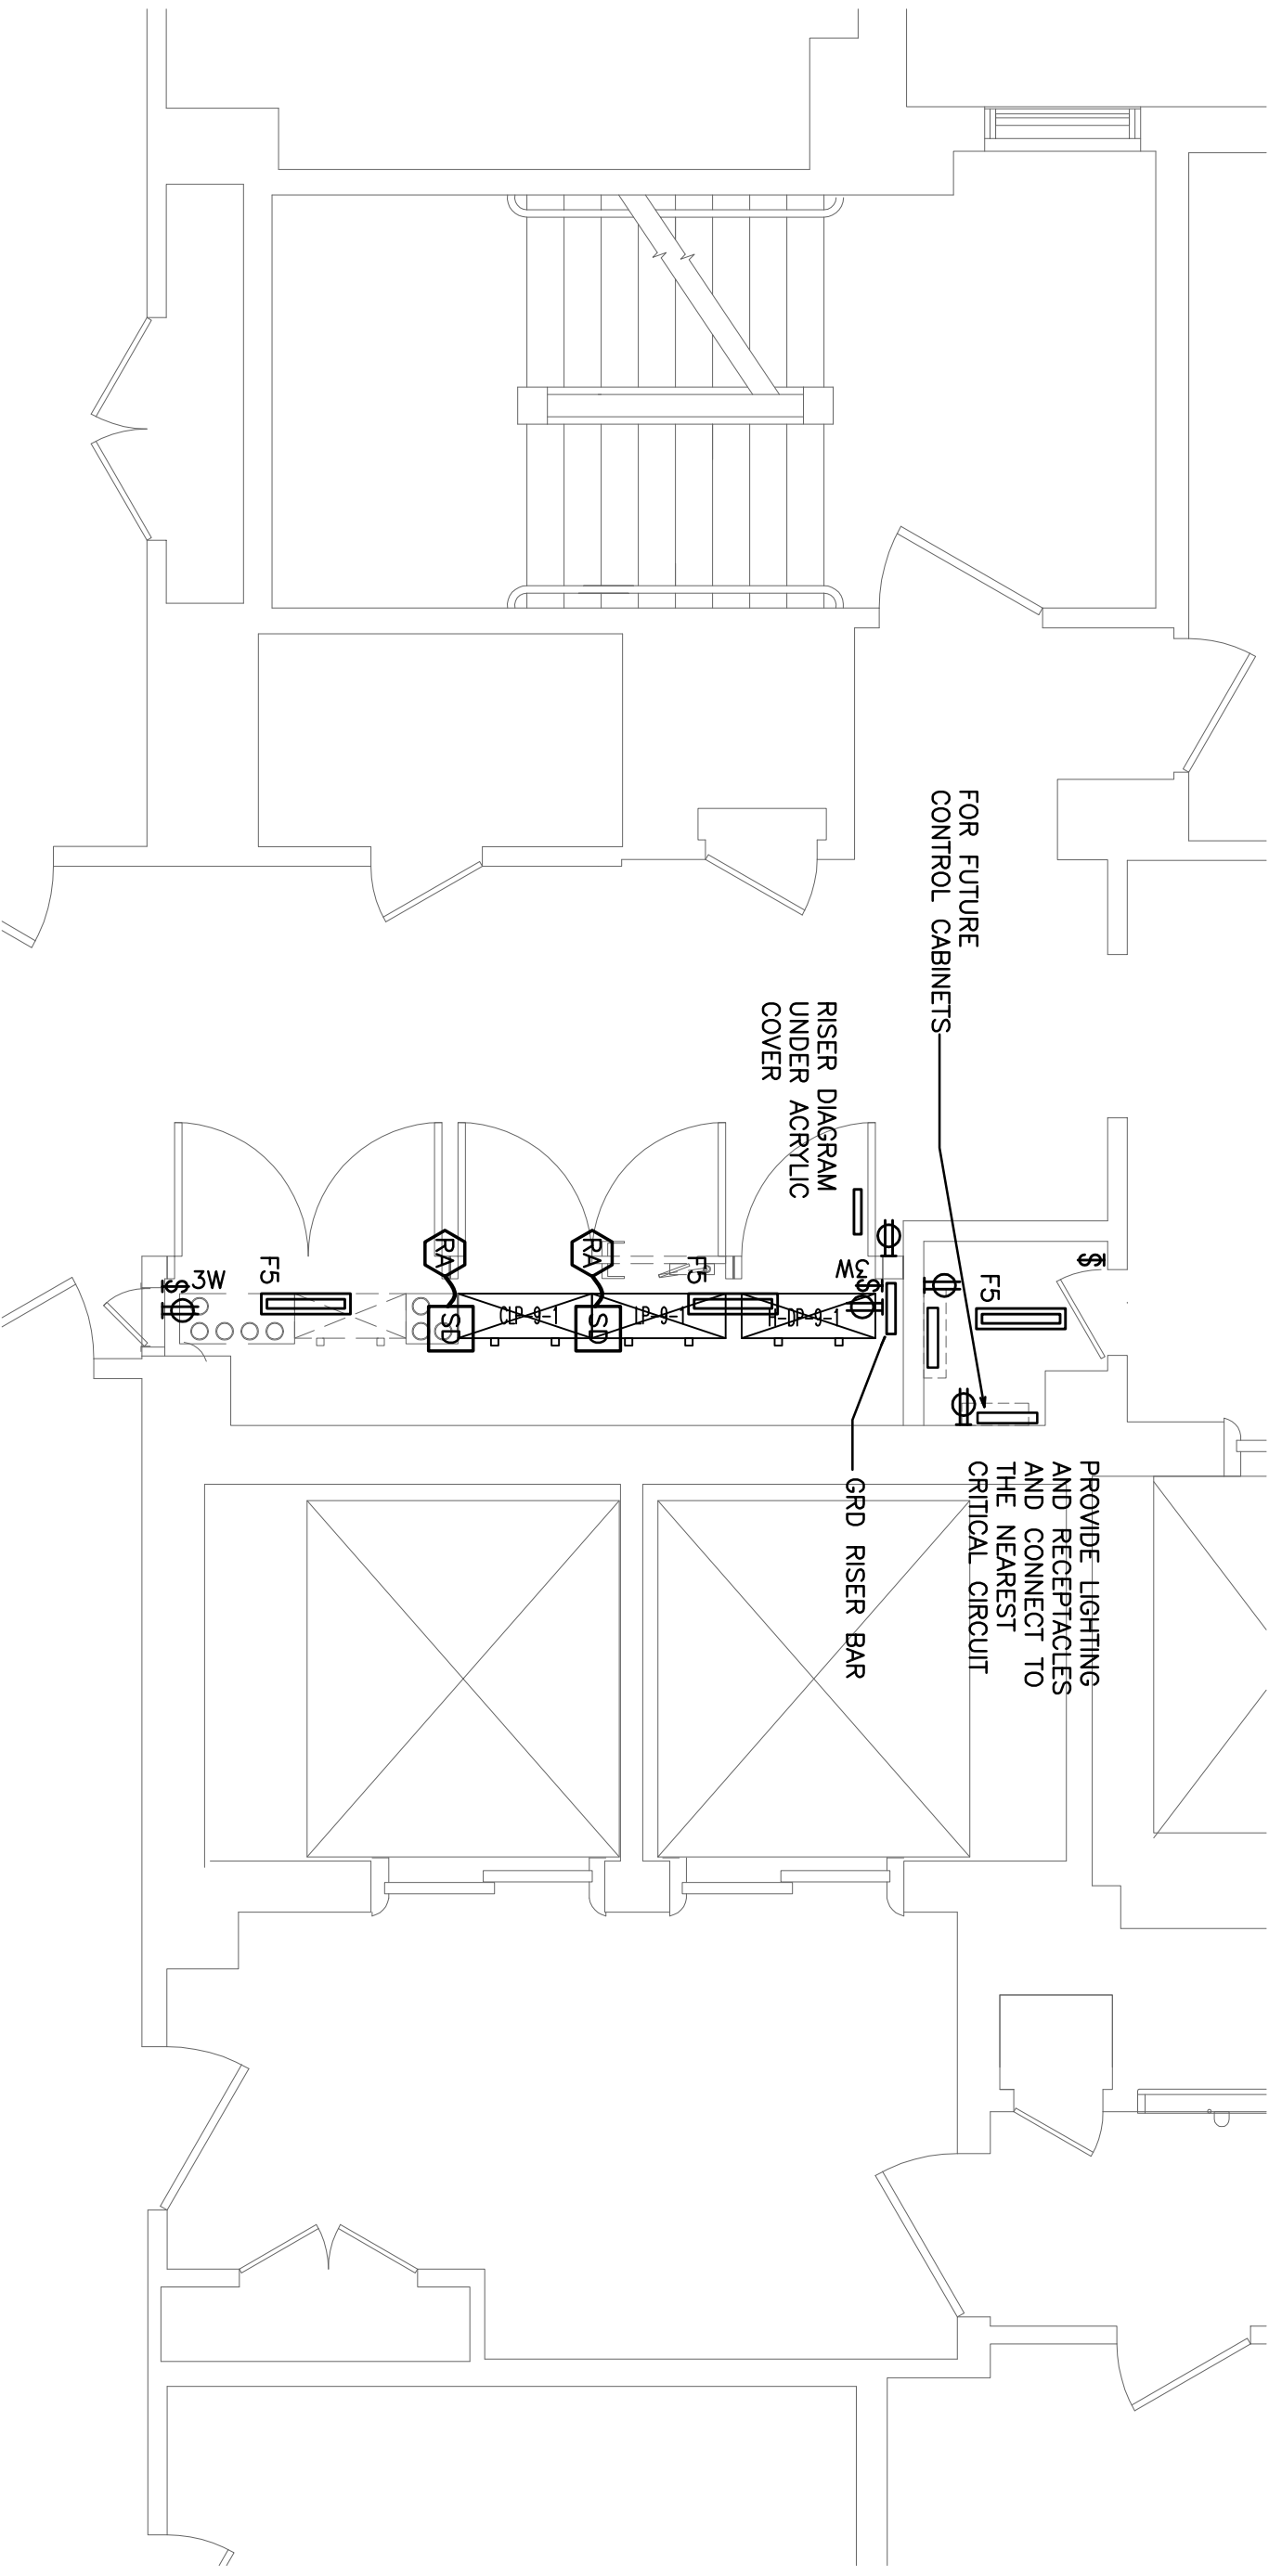





1 ENLARGED NINTH FLOOR PLAN

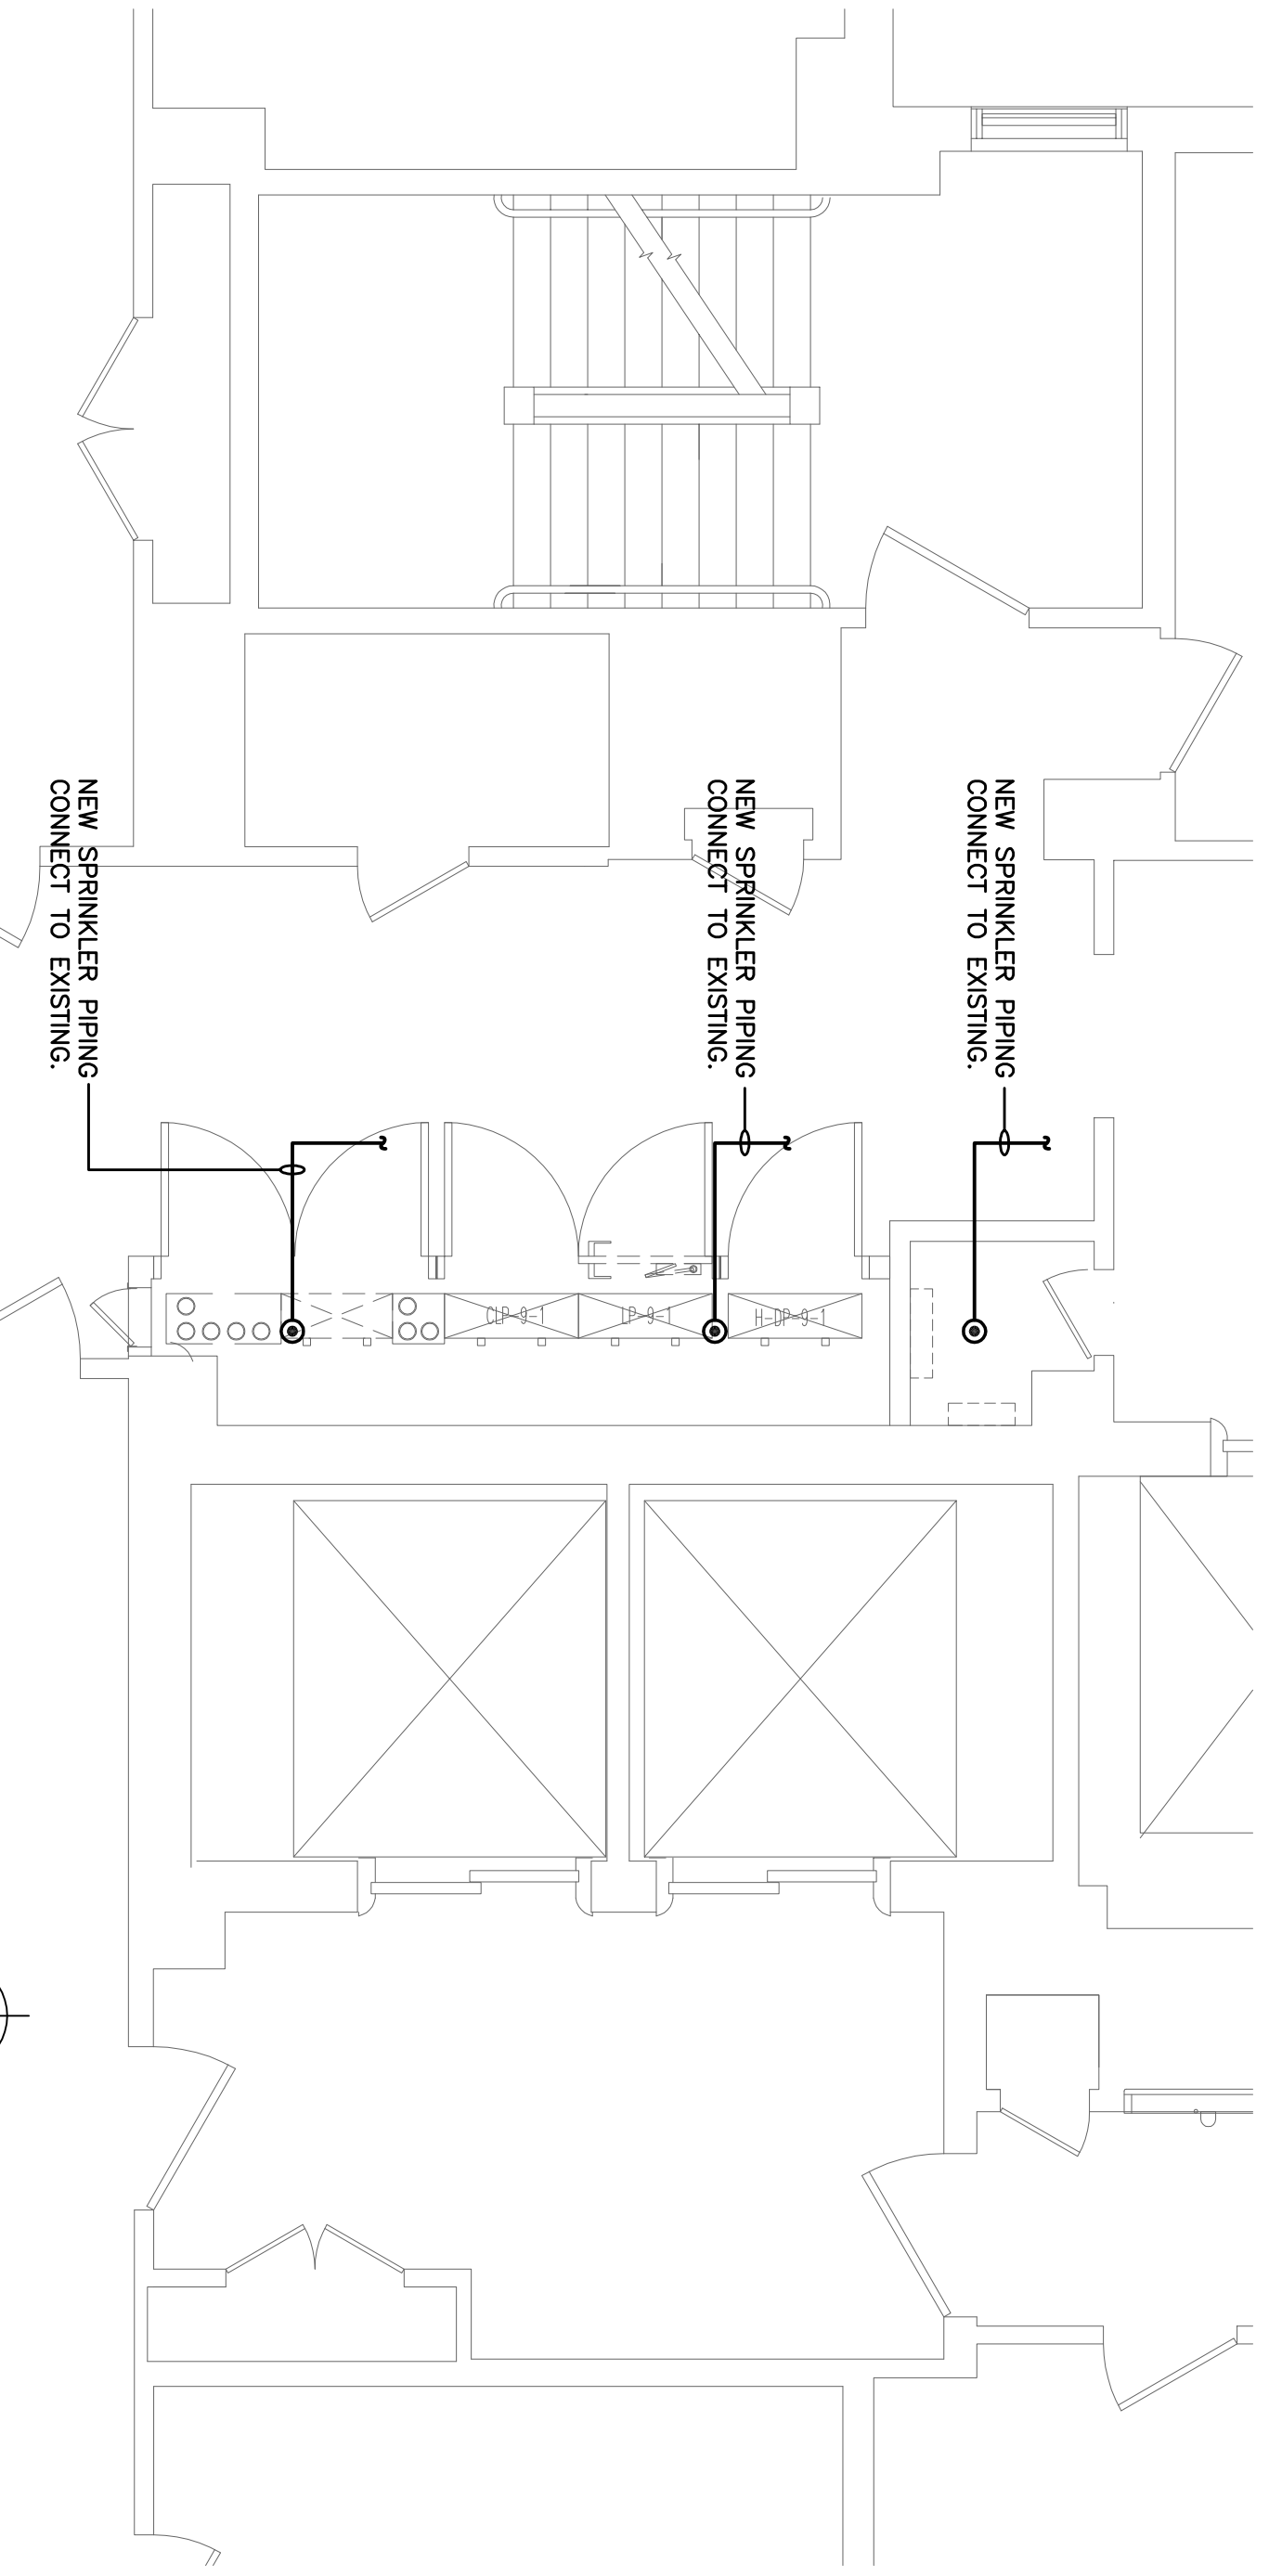


2 ENLARGED 9th FLR. ELECTRICAL PLAN



3 ENLARGED 9th FLR. FIRE PROTECTION PLAN

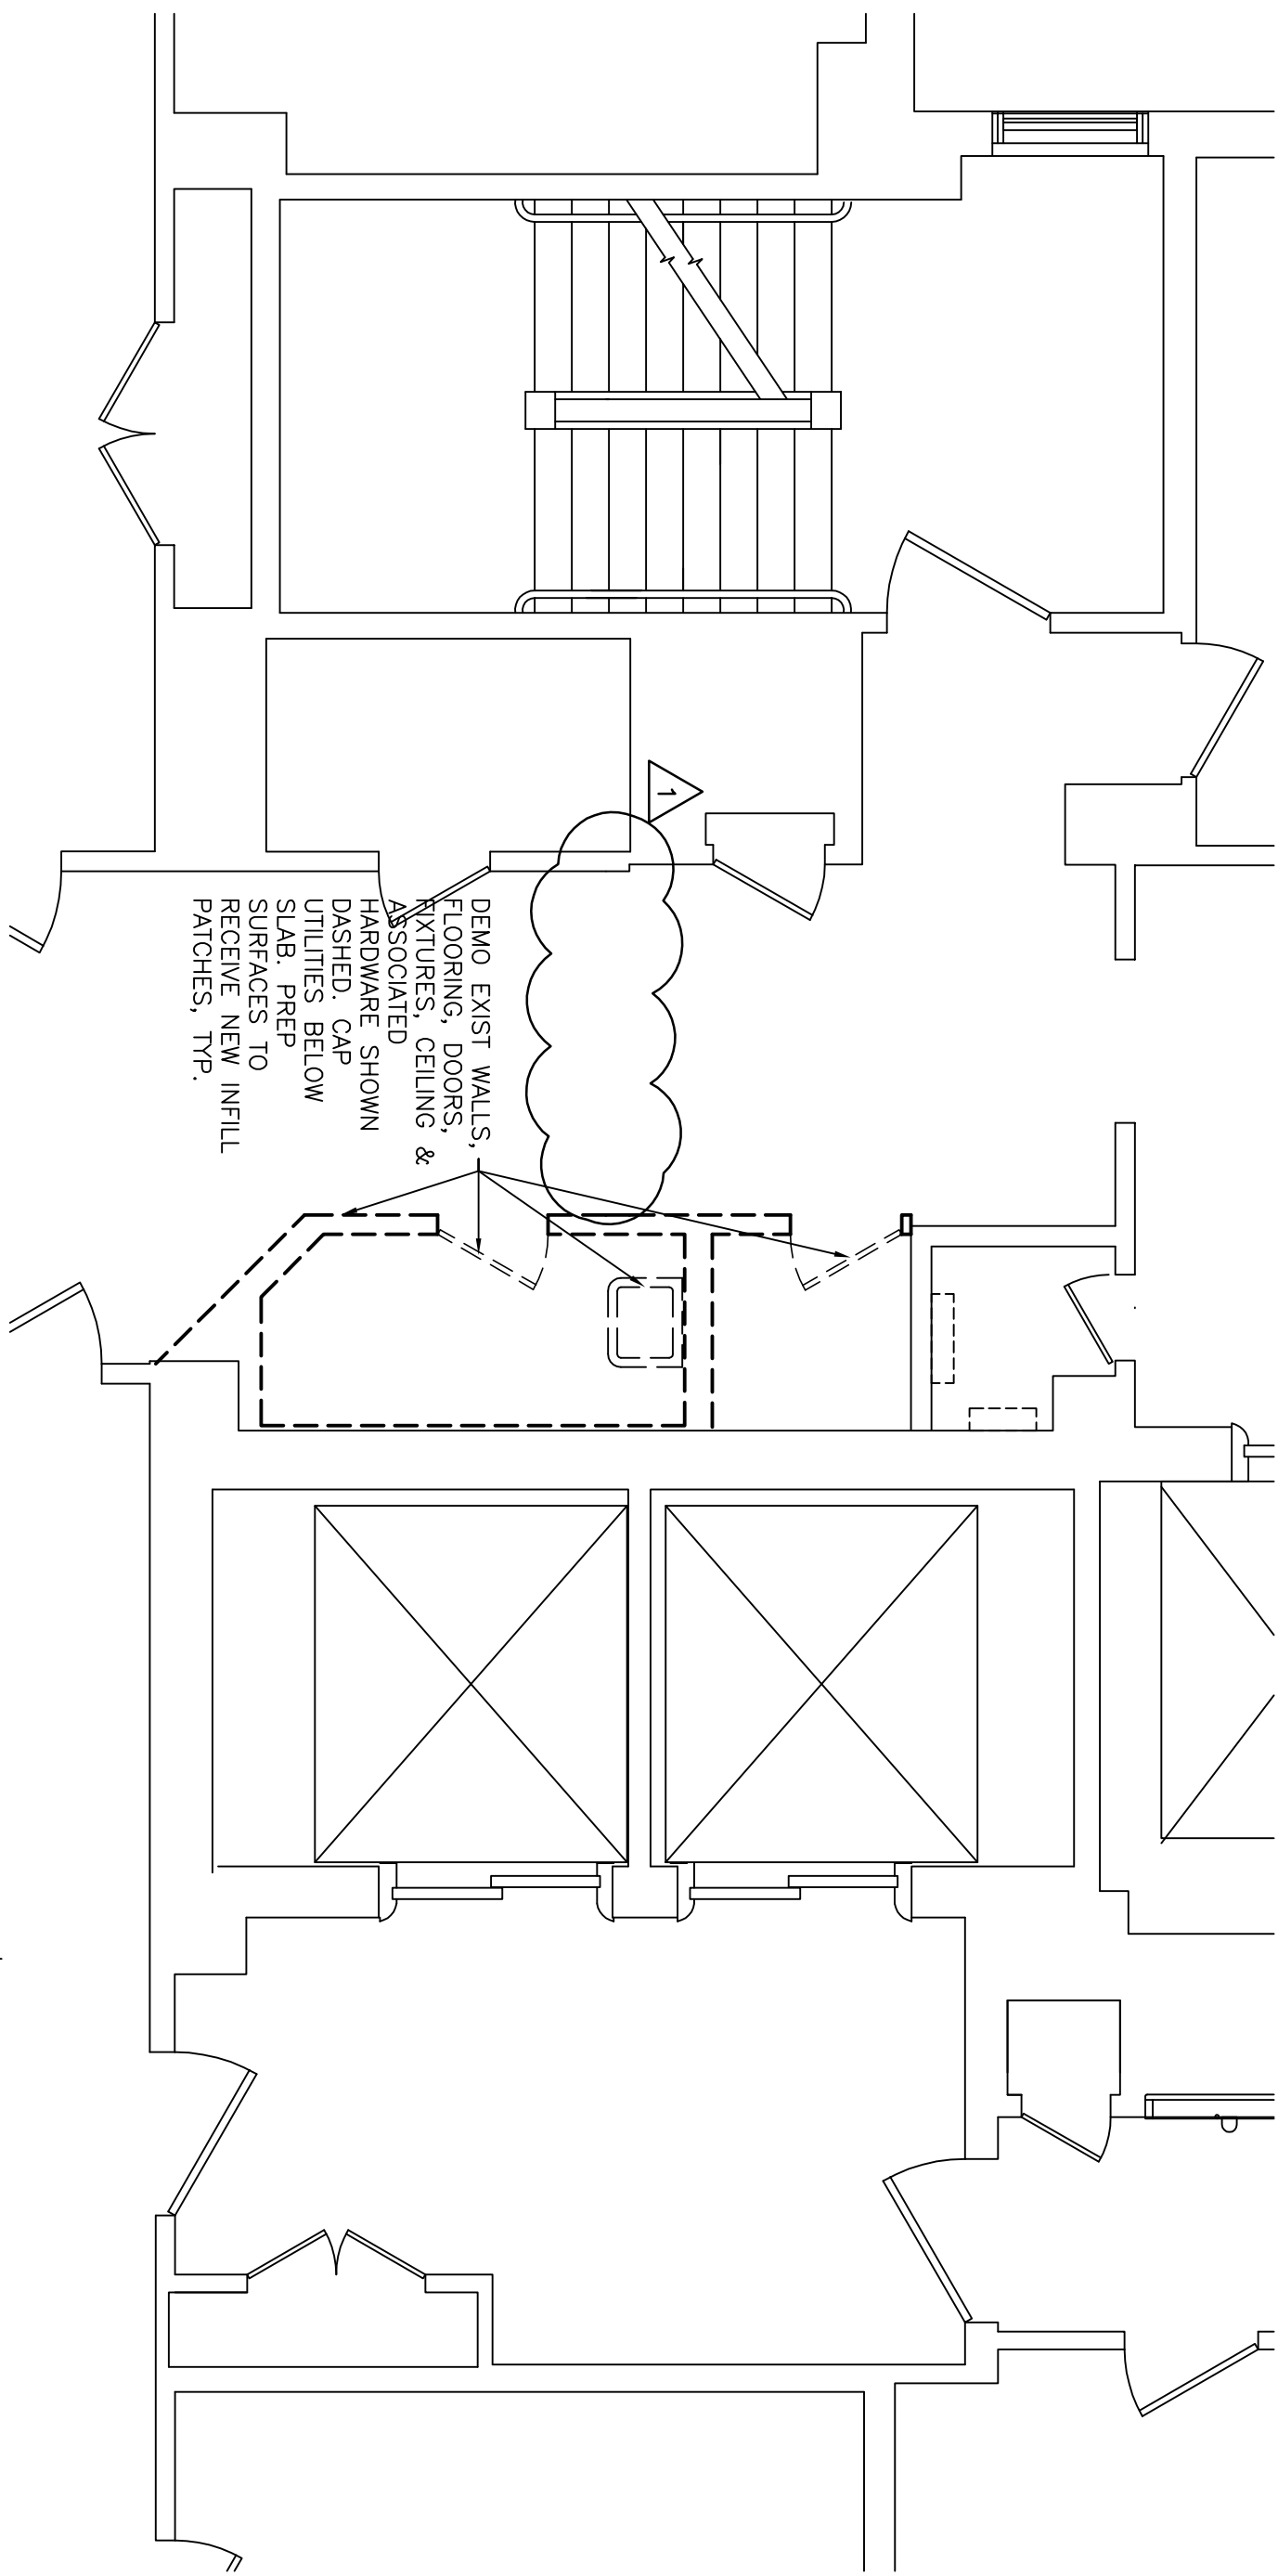


4 ENLARGED 9th FLR. DEMOLITION PLAN




GENERAL ELECTRICAL NOTES

1. RELOCATE ALL EXISTING WIRING, CONDUIT, PIPING, LUMINAIRES, WIRING DEVICES, CABLES, FIXTURES, PANELS, DUCTS, ETC., WITHIN THE CONSTRUCTION AREAS. ALL NEW WORK SHALL BE PERFORMED IN ACCORDANCE WITH JEFFA STANDARDS.
2. CAREFULLY EXAMINE THE CONTRACT DOCUMENTS, MAKE A SCHEDULED APPOINTMENT WITH THE BUILDING OWNER'S REPRESENTATIVE TO VISIT THE SITE, AND BECOME THOROUGHLY FAMILIAR WITH THE EXISTING CONDITIONS RELATING TO THE WORK. FAILURE TO DO SO WILL NOT RELIEVE THE CONTRACTOR OF THE OBLIGATIONS OF THE CONTRACT.
3. PERFORM ALL WORK REQUIRED OR NECESSARY FOR THE FULL AND COMPLETE EXECUTION OF THE WORK, WHETHER EXPLICITLY SHOWN, SPECIFIED OR NOT. EXACT EXTENT OF WORK IS NOT FULLY INDICATED ON DRAWINGS. DETERMINE THE NATURE AND EXTENT OF DEMOLITION THAT WILL BE REQUIRED TO ACCOMMODATE THE DEMOLITION/NEW WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS PRIOR TO THE START OF DEMOLITION. PROVIDE OWNER WITH A LIST OF EQUIPMENT AND MATERIAL WHICH WILL BE REMOVED. THE OWNER SHALL BE RESPONSIBLE FOR THE REMOVAL OF SUCH EQUIPMENT AND MATERIAL FROM THE PREMISES AS DIRECTED BY THE CONTRACTOR. DEMOLITION WORK SHALL BE COMPLETED AND INSPECTED BY THE OWNER. DEMOLITION WORK SHALL BE COMPLETED AND INSPECTED BY THE OWNER. DEMOLITION WORK SHALL BE COMPLETED AND INSPECTED BY THE OWNER.
4. ALL EXISTING POWER, SIGNAL, AND COMMUNICATIONS SYSTEMS ARE TO REMAIN IN SERVICE. SHOULD IT BECOME NECESSARY TO SHUT-DOWN ANY SUCH SYSTEM, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF SUCH SYSTEMS. THE FINAL BID IS TO INCLUDE THE COST OF ALL TEMPORARY WIRING AND PREMIUM TIME REQUIRED FOR THE SHUT-DOWN.
5. MAINTAINING SERVICES TO UNAFFECTED AREAS WHICH ARE EXISTING TO REMAIN AT LOCATIONS WHERE THE PRESENT ELECTRICAL DEVICES, LIGHTING, OR CIRCUITRY WILL BE MODIFIED OR CHANGED TO ACCOMMODATE THE DEMOLITION/NEW WORK, THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL NECESSARY CONDUIT AND WIRE TO MAINTAIN ELECTRICAL SERVICE TO ROOMS OR SPACES, DEVICES, ETC., WITHIN OR BEYOND THE AFFECTED AREAS.
6. EXISTING WIRING DISCONNECTED OR NO LONGER IN USE, EXISTING WIRING DISCONNECTED OR NO LONGER IN USE SHALL BE REMOVED BACK TO THE ORIGINAL LOCATION AND DISPOSED OF PROPERLY. EXISTING WIRING DISCONNECTED OR NO LONGER IN USE SHALL BE REMOVED BACK TO THE ORIGINAL LOCATION AND DISPOSED OF PROPERLY.
7. WHERE EXISTING CONDUIT RACEWAY SYSTEMS ARE SHOWN ON THE DRAWINGS, THEY ARE ILLUSTRATED DIAGRAMMATICALLY. THE EXACT ROUTING OF THE EXISTING CONDUIT RACEWAY SYSTEMS SHALL BE DETERMINED ON THE JOB SITE BY THE CONTRACTOR.
8. EXISTING CONDITIONS OF ALL EQUIPMENT, DEVICES, FIXTURES, AND SYSTEMS THAT REQUIRE REMOVAL, REUSE, RELOCATION, OR REPAIRING SHALL BE FIELD VERIFIED PRIOR TO COMMENCEMENT OF ANY WORK TO BE COMPLETELY OPERATIONAL. SUBMIT A WRITTEN STATEMENT AND ITEMIZED LISTING OF ALL EXISTING CONDITIONS OF THE FOLLOWING, ALTHOUGH NOT LIMITED TO THOSE LISTED:
 - a. LIGHTING AND RECEPTACLES.
 - b. RISER BARS, RACEWAY SYSTEMS, AND SYSTEMS.
 - c. LIGHTING AND RECEPTACLES.
 - d. LIGHTING AND RECEPTACLES.
9. SUBMIT CONSTRUCTION PLAN TO THE CORP PRIOR TO WORK. IN THE EVENT THAT THE CONTRACTOR COMMENCES WORK WITHOUT AN APPROVED SUBMITTAL, THE CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY AND COST TO MAINTAIN THE ABOVE IN GOOD WORKING ORDER AND CONDITION.
10. ALL THE EXISTING MEP EQUIPMENT WHICH INTERFERES WITH THE NEW ADDITION OR THE REMOVAL OF EXISTING WALLS SHALL BE REMOVED OR RELOCATED BY THE CONTRACTOR. VERIFY REMOVAL AND NEW LOCATION OF EQUIPMENT WITH THE CORP PRIOR TO WORK.
11. VERIFY CLEARANCES FOR ALL NEW OR EXISTING RELOCATED ELECTRICAL WORK BEFORE PROCEEDING WITH CONSTRUCTION. COORDINATE USAGE OF AVAILABLE SPACE WITH ALL TRADES IN THE EVENT OF CONFLICTS. NOTIFY THE CORP BEFORE PROCEEDING WITH THE WORK.
12. ALL CUTTING, GRINDING, AND REMOVAL OF MASONRY, CONCRETE, STEEL, OR ROOF WORK SHALL BE PERFORMED BY THE CONTRACTOR. IN ORDER THAT WORK MAY BE PROPERLY INSTALLED, AN ALLOWANCE OF COSTS TO REMOVAL OF EXISTING ROOF OR ULTRA FLOOR SLABS PRIOR TO WORK, UNDER NO CONDITIONS MAY STRUCTURAL WORK BE MODIFIED OR CUT, EXCEPT AT THE DIRECTION OF THE CORP AND THE APPROVED STRUCTURAL ENGINEER.

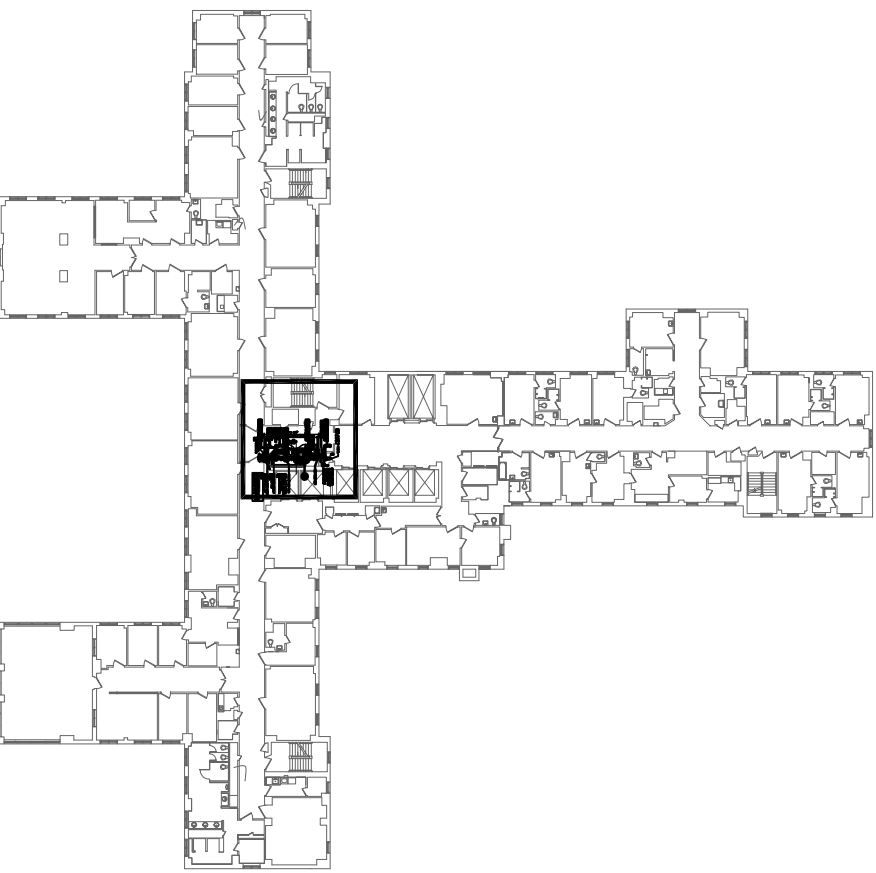

BUILDING 1 - 9th FLR. KEY PLAN

NTS



COMPLETION ITEM NO.

FULLY SPRINKLERED

CONSULTANTS:		ARCHITECT/ENGINEERS:		Drawing Title		Project Title		Office of Construction and Facilities Management	
ADDENDUM	5/24/2012	ADDENDUM	5/24/2012	NINTH FLOOR PLAN		EMERGENCY POWER DISTRIBUTION - BLDG 1		537-11-139	
ISSUED FOR SOLICITATION	4/28/2012	ISSUED FOR SOLICITATION	4/28/2012	Approved Project Director		JESSE BROWN V.A.M.C.		Building Number 1C	
100% COORDINATION	2/15/2012	100% COORDINATION	2/15/2012	Location		JESSE BROWN V.A.M.C.		Drawing Number 537-1C-AE-109	
100% DESIGN SUBMITTAL REVIEW	2/15/2012	100% DESIGN SUBMITTAL REVIEW	2/15/2012	Date		FEBRUARY 1, 2012		Dwg 11 d 17	
70% DESIGN SUBMITTAL REVIEW	11/13/2012	70% DESIGN SUBMITTAL REVIEW	11/13/2012	Checked		JJC			
SCHEMATIC DESIGN SUBMITTAL	10/2/2011	SCHEMATIC DESIGN SUBMITTAL	10/2/2011	Drawn		JJC			
Revisions	Date	Revisions	Date						